



MURSHIDABAD REGION
48, NAYA SARAK ROAD
P.O.: BERHAMPORE
DIST: MURSHIDABAD

TENDER NOTICE NO: 03 /2023

Date: 18.11.2023


Notice inviting quotation/rate for Electrical work for new premises of our Arjunpur Branch

Sealed quotations are invited for seeking rates of the wooden furniture as per sketched map attached herewith on or before **02.12.2023**.

The interested firms/ vendors can either submit their quotation in person to Regional Office Murshidabad (at Letter Receive Section) on any working day during office hours or may send by post so that the same reaches this office within the stipulated date. The quotations will be opened at R.O. on **04.12.2023 at 12:00 Noon**. The interested firms/ vendors may be present during opening of such quotations.

Terms and conditions

1. Quotation Rate will be considered on Lower Rate basis. Materials are to be supplied with a sharing basis of 60:40 between L1 and L2 bidder, provided L2 bidder agrees to supply at the lowest quoted rate. In case of dissent from L2 bidder, Bank's decision will be final.
2. Rates are to be quoted as per work schedule attached herewith.
3. Firms must have GST registration number.
4. After expiry of the above time schedule no quotation will be accepted.
5. Bank reserves the right to accept or cancel bid unilaterally without assigning any reason thereof, prior to placement of supply order/signing of contract thereby incurring any liability to the affected bidder(s) or any obligation to inform the affected bidder(s) for the cause of banks action and no further correspondence will be entertained regarding the matter.
6. All stipulated work is to be done in due time and any deviation/delay may attract penalty from original bill.
7. Selected vendor will have to finish the stipulated work in due time. Otherwise they will be debarred from getting order for their other selected items and/or their further participation in the tender process may be suspended.
10. The rate/s will be inclusive of delivery charges & others but exclusive GST.
11. Materials will be rejected if any defect/deviation in quality from specification is found as given in tender process.


Regional Manager




ELECTRICAL WORK

SL. NO	ITEM DESCRIPTION	UNIT	QT	RATE (RS.)	AMOUNT (RS.)
1	SWITCH FUSE UNIT Supply and fixing of main Switch Fuse Unit (IS : 13947) with re-wearable type fuse in sheet steel enclosure with cable end box, mounted on M.S. frame/ M.S. legs on wall. The rate shall be inclusive of supply of all materials, making holes, mending good damages & making connection etc. as required.				
1.1	63A DP SFU (for Supplies incomer)	Each	1		
2	ON LOAD CHANGE OVER SWITCH Supply & fixing of 63A, DP change over switch (IS:4064) in sheet steel enclosure on MS angles/ legs on wall. The rate shall be inclusive of supply of all materials, making holes mending good the damages & making connection etc. as required.	Each	1		
3	SUBMAIN WIRING Submain wiring with following sizes Finolex make 1100 V grade, single core, PVC insulated flexible copper conductor cable (IS:694) through suitable size medium duty PVC Conduit (ISI marked embossed on conduit surface) complete with junction box, circular box, elbows, bends and other accessories on surface above false ceiling or concealed by chase cutting on wall as per condition, mending good all damages to original finish, interconnection etc. as per required to be complete in all respect.				
3.1	With 2 nos. 6sq.mm. + 1 No. 2.5sq.mm. PVC insulated Copper wire in 20mm dia. PVC conduit (main Meter / switch to change over / main DB)	Mtr	30		
4	CASH COUNTER POINT WIRING Point wiring with 1100 V grade 2 Nos. single core 1.5 sq.mm. for common neutral by looping method common earth by looping method) PVC insulated flexible FRLS copper conductor cable (IS:694) through suitable size PVC conduit (ISI marked embossed on conduit surface) complete with junction box, circular box, elbows, bends, couplers and other accessories on surface above false ceiling or concealed by chase cutting on wall from light & fan switch board to light, fan & 6A socket outlet on the same switch board or separately mounted switch board. The work includes supply and fixing of all materials such as modular type 6A switch for each light and fan point, 6A 2/3 pin shuttered socket outlet with switch, 3 plate ceiling rose/ angle or batten holder etc. as required The point wiring also includes circuit wiring with 1100V grade 2 nos. single core 2.5sq.mm. (1 for phase and 1(Black colour) for neutral) + 1no. Single core 1.5 sq.mm. PVC insulated flexible (FRLS) paper conductor cable (IS:694) through suitable size PVC conduit as described above from DB to switch board, interconnection, mending good all damages to original finish, etc. as required to be completed in all respect. All connections of wires to be done by means of "Wago" type connectors. (All wiring in strong room, locker room, records & stationary room of surface conduit type)				
4.1	1 Light & fan control by 1 switch	Each	4		
4.2	2 nos, 2/3 pin 6A switch shuttered socket outlet with switch on light & fan switch board	Each	2		
4.3	2x6A 2/3 pin shuttered socket with individual controlling switch on light/ fan switch board for cash counter.	Each	2		
4.4	1x16A 2/3 pin shuttered with switch on separate switch board other than light & fan switch board cash counter.	Each	2		
4.5	Wall mounted bracket fan point	Each	2		
5	MCB DISTRIBUTION BOARD Supply, installation testing and commissioning of MCB Distribution Board in sheet steel enclosure with double door and suitable for mounting on surface wall by the Electrical Layout complete in all respect, (Havells / HPL make)				
5.1	MAIN DISTRIBUTION BOARD (Main DB) TPN 8 way SPN MCB DB complete with MCBs : Incoming : 1 nos. : 240V, 63A DP MCB Outgoing 4 nos. : 240V, 32A SP MCB, 2 nos. : 240V, 10A, SP, MCB ,Complete board as above.	Each	1		
6	SUPPLY & INSTALLATION OF LIGHT FITTINGS :				
6.1	Supply installation, testing and commissioning of 1x24W T5 light fittings with light on wall/ ceiling including supplying and fixing of 2nos. M.S. clamps or hard wood round block property shellac polished with 2x20mm dia MS pipe suitable for wall/ ceiling mounting including interconnection between light points and fittings 3 nos. single core/ 3core 1.5sq.mm. PVC insulated flexible FRLS copper conductor cable etc. as required	Each	10		
6.2	Supply, installation, testing and commissioning of 1x10 Watt light fittings installation the cash counter.	Each	2		
7	SUPPLY INSTALLATION OF FAN FITTINGS				
7.1	Supply, installation, testing and commissioning of heavy duty type ISI marked 400mm dia. Wall bracket fan suitable for 240V single phase 50Hz. A.C. supply complete with all accessories, mending good etc. as required, cash counter.	Each	2		
7.2	Supply and fixing of fan hook after cutting ceiling and welding with main reinforcement	Each	10		



NO	ITEM DESCRIPTION	UNIT	QT	RATE (RS.)	AMOUNT (RS.)
	including mending good all damages to original finish				
8	INDUSTRIAL TYPE SOCKET AND PLUG DB Supply and installation of industrial type socket and match plug with controlling MCB in sheet enclosure for UPS incoming outgoing only : (Havells/HPL make)				
8.1	32A, 3 pin industrial type socket with matching plug and 25A, DP MCB control including interconnection (for UPS incoming/ outgoing) (Havells/HPL make)	Each	2		
9	UPS TO UPS CHANG OVER Supply & fixing of 32ADP on load change Over Switch in sheet steel enclosure on M.S. angles/ legs on wall. The rate shall be inclusive of supply of all materials, making holes, mending well the damages & making connection etc. as required. (Havells/HPL make)	Each	1		
10	COMPUTER DISTRIBUTION BOARD (CDB) Supply and installation of metallic single door MCB distribution Board with MCB having breaking capacity of 10KA (minimum) and complete with busbar, interconnection, mounted on flat iron frame on wall/ flushed with finished wall by chase cutting, mending good to original finish etc. as required name plate & number of DBs are to be fixed up on front door of DBs for their identification. (Havells/HPL make)				
10.1	SPN 8 way consumer unit single door MCB DB complete with busbar and the following MCBs: OUTGOING 1 nos. 240V, 40A DP MCB 6nos. 240V, 10A, SP MCB	Each	1		
11	SUBMAIN WIRING Submain wiring with 1100V grade. Single core PVC insulated flexible copper conductor cable (IS: 694) through suitable size medium duty PVC conduit (ISI mark embossed on conduit surface) and conduit accessions partly on surface (above false ceiling) with MS bar saddles. Partly through portion and partly concealed in wall/ embedded. Mending good all damages etc. as required to be completed in all respect				
11.1	From plug socket D.B. & from outgoing/incoming plug socket DB with CDB 2nos. 4sq.mm. + 1no. 2.5sq.mm. PVC insulated flexible FR copper conductor cable in suitable size PVC conduit.	Mtr.	25		
11.2	From (CDB) DB to power board with 3nos. 1.5sq.mm. PVC insulated flexible FR copper conductor cable is suitable size PVC conduit.	Mtr.	160		
12	COMPUTER SOCKET OUTLET CLUSTER POINT WIRING Computer socket outlet cluster point wiring with 1100 V grade 3 nos. single core 2.5 sq. mm. PVC insulated flexible FRLS copper conductor cable confirming to IS : 694 through suitable size partly concealed in wall/ embedded in floor, partly on surface above false ceiling and partly through partition or through flexible conduit from DB to socket clusters in 1 (one) circuit connection by looping method. The work includes supply and flexing of socket out let cluster component/ each as detailed below:- Each computer socket outlet cluster comprising the following : 3 nos. 6A 2/3 pin modular type shuttered socket. (below table) 1 nos. 20A modular type controlling switch. (below table) 1nos. 10A modular type intrigrating lamp (below table) 1 nos. modular type Front plate of suitable size. 1 nos. modular type PVC box of suitable size.	Each	8		
13	EARTHING (COMPUTER) Earthling the installation as per I.E. rules confirming to IS:3043-1987 or its latest amendment by making earth station with 450mm. X 6mm. (minimum) thick copper plate electrode installed level after preparation of ground with charcoal and salt and connecting the earth lead- in- wire by suitable length double nuts and washers copper lugs including supply and fixing of 50mm. dia. Partly perforated G.I. pipe with funnel for watering arrangement. The copper earth lead-in-strip shall be PVC sleeved/ insulated throughout the total length and the underground portion to be laid through suitable size heavy duty rigid PVC conduit (ISI mark embossed on conduit surface) at an average depth of 500mm below ground level. The earthing installation provided with 300mmx300mm and 300mm	Each	1		
14	SUPPLYING AND LAYING OF PVC. CONDUIT. Supplying and laying of 20mm. dia heavy duty rigid PVC conduit complete with junction box. circular box, elbows, bends, couplers and other accessories as required on wall embedded in floor or on surface or through partition. The work includes making good etc. as required.	Mtr	50		

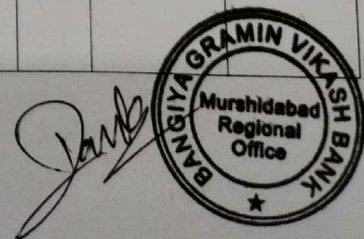

SL. NO	ITEM DESCRIPTION	UNIT	QT	RATE (RS.)	AMOUNT (RS.)
15	COMPUTER DATA WIRING Supply and laying of CAT – 6 cables through pre-laid rigid PVC conduit as shown in the drawing or otherwise as directed by the consultant from server to HUB, HUB to Computer Data Socket including interconnection mending good, etc. as required.	Mtr	195		
16	COMPUTER DATA SOCKET Supply and fixing on wall/ furniture/ portion recessed type D-Link make Computer data socket (RJ 45) with mounting box & front plate, mending good etc. as required.	Each	7		
Total					
GST : EXTRA.					

